



## Bid Notice Abstract

### Request for Quotation (RFQ)

**Reference Number** 12963229  
**Procuring Entity** CARLOS HILADO MEMORIAL STATE UNIVERSITY  
**Title** Procurement of Labor and Materials for Electrical Installation for Rooms 3 & 4 IT Laboratory - Binalbagan Campus  
**Area of Delivery** Negros Occidental

<b>Solicitation Number:</b> RFQ 26-144	<b>Status</b>	<b>In-Preparation</b>
<b>Trade Agreement:</b> Implementing Rules and Regulations	<b>Associated Components</b>	2
<b>Procurement Mode:</b> Negotiated Procurement - Small Value Procurement (Sec. 53.9)	<b>Bid Supplements</b>	0
<b>Classification:</b> Civil Works	<b>Document Request List</b>	0
<b>Category:</b> Construction Projects	<b>Date Published</b>	06/05/2026
<b>Approved Budget for the Contract:</b> PHP 70,000.00	<b>Last Updated / Time</b>	05/05/2026 10:21 AM
<b>Delivery Period:</b> 14 Day/s	<b>Closing Date / Time</b>	12/05/2026 17:00 PM
<b>Client Agency:</b>		
<b>Contact Person:</b> Rowena De la Vida Prado Administrative Assistant II Mabini Street Talisay City Negros Occidental Philippines 6115 63-34-7120005 Ext.142 63-939-9296624 bac.sec@chmsu.edu.ph		

**Description**

Republic of the Philippines  
 CARLOS HILADO MEMORIAL STATE UNIVERSITY  
 Talisay City, Negros Occidental  
 Mobile Phone Number: (0920) 583 3046  
 bac.sec@chmsu.edu.ph

REQUEST FOR QUOTATION  
 Page 1 of 4  
 Date: APRIL 30, 2026  
 Quotation No. 26-144

Please quote your lowest price on the item/s listed below, stating the shortest time of delivery and submit your quotation duly signed by your representative not later than \_\_\_\_\_ in the return envelope attached herewith.

DR. MA. RIZA T. MANALO  
 BAC Chairperson

- NOTE:
1. ALL ENTRIES MAY BE TYPEWRITTEN OR LEGIBLY HANDWRITTEN
  2. DELIVERY PERIOD WITHIN 14 CALENDAR DAYS
  3. WARRANTY SHALL BE FOR A PERIOD OF SIX (6) MONTHS FOR SUPPLIES & MATERIALS, ONE (1) YEAR FOR EQUIPMENT, FROM DATE OF ACCEPTANCE BY THE PROCURING ENTITY

- 4. PRICE VALIDITY SHALL BE FOR A PERIOD OF \_\_\_\_\_ CALENDAR DAYS
- 5. G-EPS REGISTRATION CERTIFICATE SHALL BE ATTACHED UPON SUBMISSION OF THE QUOTATION
- 6. BIDDERS SHALL SUBMIT ORIGINAL BROCHURES SHOWING CERTIFICATIONS OF THE PRODUCT BEING OFFERED

ITEM DESCRIPTION OF WORKS QTY. UNIT MATERIAL COST LABOR COST TOTAL COST  
 NO. Unit Cost Material Sub-Total Cost Unit Cost Labor Sub-Total Cost  
 ONE (1) LOT  
 LABOR AND MATERIALS OF ELECTRICAL INSTALLATION FOR ROOMS 3 & 4 - IT LABORATORY

**SCOPE OF WORKS**

**1.0 GENERAL REQUIREMENTS**

- 1.1 Mobilization and Demobilization
- 1.2 Safety Occupational Hazards
- 1.3 Site Clearing,Cleaning & Hauling

**2.0 ELECTRICAL WORKS**

- 2.1 Installation of electrical outworks

**3.0 MISCELLANEOUSWORKS**

3.1 FOR ALL OTHER ITEMS that are not included on listed Bill of Quantities in your Bid but tare deemed necessary for the completion of the works and the delivery of the project.

**BILL OF QUANTITIES**

**1.0 GENERAL REQUIREMENTS**

- 1.1 Mobilization and Demobilization 1.00 lot
- 1.2 Safety Occupational Hazards 1.00 lot
- 1.3 Site Clearing,Cleaning & Hauling 1.00 lot
- Sub-total, 1.0 (GENERAL REQUIREMENTS)

**2.0 ELECTRICAL WORKS**

- 2.1.1 5.5mm2 THHN Wire 2.80 rolls
- 2.1.2 Plastic PVC Molding 2" x 2" x 8' 40.00 lgths
- 2.1.3 Pvc Surface Type Utility Box 50.00 pcs
- 2.1.4 Universal Outlet 2 Gang 86.00 set
- 2.1.5 Flexible hose 1/2" 1.00 roll
- Sub-total, 2.0 (ELECTRICAL WORKS)

**3.0 MISCELLANEOUS WORKS**

3.1 FOR ALL OTHER ITEMS that are not included on listed Bill of Quantities in your Bid but tare deemed necessary for the completion of the works and the delivery of the project.  
 Sub-total, 3.0 (MISCELLANEOUS WORKS)

PROJECT DURATION: 14 CALENDAR DAYS

Note: Attach Certificate of Site Inspection

A. TOTAL DIRECT COST

B. CONSUMABLES:

C. SUPERVISION AND ADMINISTRATION:

D. TOTAL INDIRECT COST (B+C):

E. TOTAL COST (A+D)

F. VAT (12% OF ITEM E):

GRAND TOTAL OF PROJECT COST:

\*\*\*\*\*NOTHING FOLLOWS\*\*\*\*\*

TOTAL ABC = Php 70,000.00

PROCUREMENT OF LABOR AND MATERIALS FOR THE ELECTRICAL INSTALLATION FOR ROOMS 3 & 4 - IT LABORATORY - BINALBAGAN CAMPUS / J. VERGARA (Executive Director)

PR# 26-231-0330 03-30-26

MDS 122-101-26-04 04-08-25

**Line Items**

Item No.	Product/Service Name	Description	Quantity	UOM	Budget (PHP)
1	One (1) Lot	Labor and Materials for Electrical Installation for Rooms 3 & 4 IT Laboratory - Binalbagan Campus	1	Lot	70,000.00

**Created by** Rowena De la Vida Prado

**Date Created** 05/05/2026

The PhilGEPS team is not responsible for any typographical errors or misinformation presented in the system. PhilGEPS only displays information provided for by its clients, and any queries regarding the postings should be directed to the contact person/s of the concerned party.



Republic of the Philippines  
**CARLOS HILADO MEMORIAL STATE UNIVERSITY**  
 Talisay City, Negros Occidental  
 Mobile Phone Number: (0920) 583 3046  
[bac.sec@chmsu.edu.ph](mailto:bac.sec@chmsu.edu.ph)


## REQUEST FOR QUOTATION

Page 1 of 4

Date: APRIL 30, 2026  
 Quotation No. 26-144

\_\_\_\_\_  
 \_\_\_\_\_

Please quote your lowest price on the item/s listed below, stating the shortest time of delivery and submit your quotation duly signed by your representative not later than \_\_\_\_\_ in the return envelope attached herewith.

  
**DR. MA. RIZA T. MANALO**  
 BAC Chairperson

**NOTE:**

1. ALL ENTRIES MAY BE TYPEWRITTEN OR LEGIBLY HANDWRITTEN
2. DELIVERY PERIOD WITHIN 14 CALENDAR DAYS
3. WARRANTY SHALL BE FOR A PERIOD OF SIX (6) MONTHS FOR SUPPLIES & MATERIALS, ONE (1) YEAR FOR EQUIPMENT, FROM DATE OF ACCEPTANCE BY THE PROCURING ENTITY
4. PRICE VALIDITY SHALL BE FOR A PERIOD OF \_\_\_\_\_ CALENDAR DAYS
5. G-EPS REGISTRATION CERTIFICATE SHALL BE ATTACHED UPON SUBMISSION OF THE QUOTATION
6. BIDDERS SHALL SUBMIT ORIGINAL BROCHURES SHOWING CERTIFICATIONS OF THE PRODUCT BEING OFFERED

ITEM NO.	DESCRIPTION OF WORKS	QTY.	UNIT	MATERIAL COST		LABOR COST		TOTAL COST
				Unit Cost	Material Sub-Total Cost	Unit Cost	Labor Sub-Total Cost	
	<b>ONE (1) LOT</b>							
	<b>LABOR AND MATERIALS OF ELECTRICAL INSTALLATION FOR ROOMS 3 &amp; 4 - IT LABORATORY</b>							
	<b>SCOPE OF WORKS</b>							
1.0	<b>GENERAL REQUIREMENTS</b>							
1.1	Mobilization and Demobilization							
1.2	Safety Occupational Hazards							
1.3	Site Clearing, Cleaning & Hauling							
2.0	<b>ELECTRICAL WORKS</b>							
2.1	Installation of electrical outworks							
3.0	<b>MISCELLANEOUS WORKS</b>							
3.1	FOR ALL OTHER ITEMS that are not included on listed Bill of Quantities in your Bid but are deemed necessary for the completion of the works and the delivery of the project.							

Released (BAC) \_\_\_\_\_ Date \_\_\_\_\_ By \_\_\_\_\_  
 Returned (Supplier) \_\_\_\_\_

\_\_\_\_\_  
 Printed Name/Signature  
 \_\_\_\_\_  
 Tel. No./Cellphone No.  
 \_\_\_\_\_  
 Date



Republic of the Philippines  
**CARLOS HILADO MEMORIAL STATE UNIVERSITY**  
 Talisay City, Negros Occidental  
 Mobile Phone Number: (0920) 583 3046  
[bac.sec@chmsu.edu.ph](mailto:bac.sec@chmsu.edu.ph)


## REQUEST FOR QUOTATION

Page 2 of 4

Date: APRIL 30, 2026

Quotation No. 26-144

Please quote your lowest price on the item/s listed below, stating the shortest time of delivery and submit your quotation duly signed by your representative not later than \_\_\_\_\_ in the return envelope attached herewith.

  
**DR. MA. RIZA T. MANALO**  
 BAC Chairperson

**NOTE:**

1. ALL ENTRIES MAY BE TYPEWRITTEN OR LEGIBLY HANDWRITTEN
2. DELIVERY PERIOD WITHIN 14 CALENDAR DAYS
3. WARRANTY SHALL BE FOR A PERIOD OF SIX (6) MONTHS FOR SUPPLIES & MATERIALS, ONE (1) YEAR FOR EQUIPMENT, FROM DATE OF ACCEPTANCE BY THE PROCURING ENTITY
4. PRICE VALIDITY SHALL BE FOR A PERIOD OF \_\_\_\_\_ CALENDAR DAYS
5. G-EPS REGISTRATION CERTIFICATE SHALL BE ATTACHED UPON SUBMISSION OF THE QUOTATION
6. BIDDERS SHALL SUBMIT ORIGINAL BROCHURES SHOWING CERTIFICATIONS OF THE PRODUCT BEING OFFERED

ITEM NO.	DESCRIPTION OF WORKS	QTY.	UNIT	MATERIAL COST		LABOR COST		TOTAL COST
				Unit Cost	Material Sub-Total Cost	Unit Cost	Labor Sub-Total Cost	
<b>BILL OF QUANTITIES</b>								
<b>1.0</b>	<b>GENERAL REQUIREMENTS</b>							
1.1	Mobilization and Demobilization	1.00	lot					
1.2	Safety Occupational Hazards	1.00	lot					
1.3	Site Clearing, Cleaning & Hauling	1.00	lot					
	<b>Sub-total, 1.0 (GENERAL REQUIREMENTS)</b>							
<b>2.0</b>	<b>ELECTRICAL WORKS</b>							
2.1.1	5.5mm2 THHN Wire	2.80	rolls					
2.1.2	Plastic PVC Molding 2" x 2" x 8'	40.00	lgths					
2.1.3	Pvc Surface Type Utility Box	50.00	pcs					
2.1.4	Universal Outlet 2 Gang	86.00	set					
2.1.5	Flexible hose 1/2"	1.00	roll					
	<b>Sub-total, 2.0 (ELECTRICAL WORKS)</b>							
<b>3.0</b>	<b>MISCELLANEOUS WORKS</b>							

Date \_\_\_\_\_ By \_\_\_\_\_

Released (BAC) \_\_\_\_\_

Returned (Supplier) \_\_\_\_\_

Printed Name/Signature

Tel. No./Cellphone No.

Date



Republic of the Philippines  
**CARLOS HILADO MEMORIAL STATE UNIVERSITY**  
 Talisay City, Negros Occidental  
 Mobile Phone Number: (0920) 583 3046  
[bac.sec@chmsu.edu.ph](mailto:bac.sec@chmsu.edu.ph)


## REQUEST FOR QUOTATION

Page 3 of 4

Date: APRIL 30, 2026  
 Quotation No. 26-144

\_\_\_\_\_  
 \_\_\_\_\_

Please quote your lowest price on the item/s listed below, stating the shortest time of delivery and submit your quotation duly signed by your representative not later than \_\_\_\_\_ in the return envelope attached herewith.

  
**DR. MA. RIZA T. MANALO**  
 BAC Chairperson

**NOTE:**




1. ALL ENTRIES MAY BE TYPEWRITTEN OR LEGIBLY HANDWRITTEN
2. DELIVERY PERIOD WITHIN 14 CALENDAR DAYS
3. WARRANTY SHALL BE FOR A PERIOD OF SIX (6) MONTHS FOR SUPPLIES & MATERIALS, ONE (1) YEAR FOR EQUIPMENT, FROM DATE OF OF ACCEPTANCE BY THE PROCURING ENTITY
4. PRICE VALIDITY SHALL BE FOR A PERIOD OF \_\_\_\_\_ CALENDAR DAYS
5. G-EPS REGISTRATION CERTIFICATE SHALL BE ATTACHED UPON SUBMISSION OF THE QUOTATION
6. BIDDERS SHALL SUBMIT ORIGINAL BROCHURES SHOWING CERTIFICATIONS OF THE PRODUCT BEING OFFERED

ITEM NO.	DESCRIPTION OF WORKS	QTY.	UNIT	MATERIAL COST		LABOR COST		TOTAL COST
				Unit Cost	Material Sub-Total Cost	Unit Cost	Labor Sub-Total Cost	
3.1	FOR ALL OTHER ITEMS that are not included on listed Bill of Quantities in your Bid but tare deemed necessary for the completion of the works and the delivery of the project.							
	<b>Sub-total, 3.0 (MISCELLANEOUS WORKS)</b>							
	PROJECT DURATION: 14 CALENDAR DAYS							
	Note: Attach Certificate of Site Inspection							
	<b>A. TOTAL DIRECT COST</b>							
	<b>B. CONSUMABLES:</b>							
	<b>C. SUPERVISION AND ADMINISTRATION:</b>							
	<b>D. TOTAL INDIRECT COST (B+C):</b>							
	<b>E. TOTAL COST (A+D)</b>							
	<b>F. VAT (12% OF ITEM E):</b>							

Released (BAC) \_\_\_\_\_ Date \_\_\_\_\_ By \_\_\_\_\_  
 Returned (Supplier) \_\_\_\_\_

\_\_\_\_\_  
 Printed Name/Signature  
 \_\_\_\_\_  
 Tel. No./Cellphone No.  
 \_\_\_\_\_  
 Date



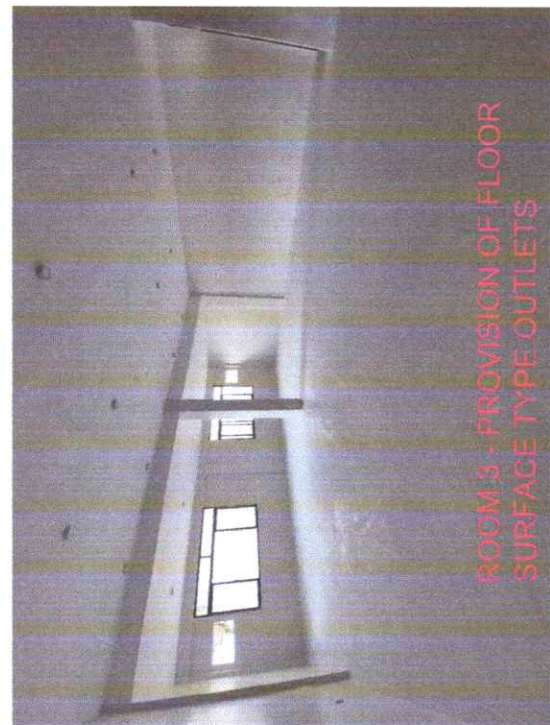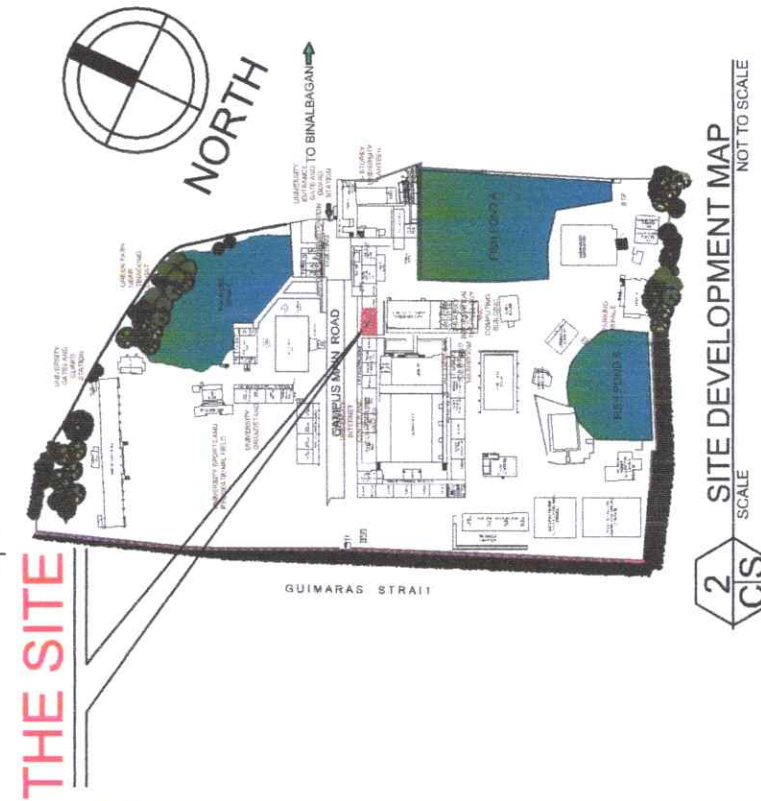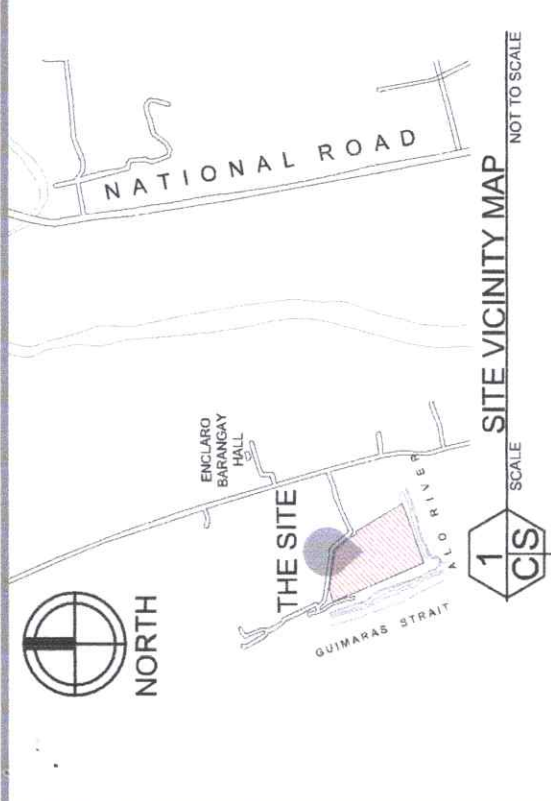

**3 CS** SCALE NOT TO SCALE

**EXISTING STRUCTURE**


SHEET	TITLE
ELECTRICAL	
CS	SITE VICINITY MAP
	SITE DEVELOPMENT MAP
	EXISTING STRUCTURE
E-1	EXISTING FLOOR PLAN
	GENERAL NOTES
E-2	LEGENDS
	CONVENIENCE OUTLET LAYOUT
E-3	SCHEDULE OF LOADS
	SINGLE LINE DIAGRAM

<p>Office of the Project Management Unit</p>	<p>PROJECT TITLE: Labor and Materials for Electrical Installation for Room 3 and 4 - IT Laboratory</p> <p>PROJECT LOCATION: BINALAGAN CAMPUS</p>	<p>ENDORSED BY: <i>Jovelle B. Vergara</i> JOVELLE B. VERGARA, EGD VICE DIRECTOR, BINALAGAN CAMPUS</p>	<p>PREPARED BY: <i>John Carlo F. Ganhon</i> MA. JOHN CARLO F. GANHON ENGINEER, BINALAGAN CAMPUS</p>	<p>CHECKED BY: <i>Engr. J. M. Chavez</i> ENGR. J. M. CHAVEZ PROJECT MANAGER, BINALAGAN CAMPUS</p>	<p>RECOMMENDING APPROVAL: <i>Jay B. Estrella</i> JAY B. ESTRELLA, EGD VICE PRESIDENT FOR ADMINISTRATION AND FINANCE</p>	<p>APPROVED BY: <i>Norberto P. Mangula</i> NORBERTO P. MANGULABNAN, Ph.D. SUC PRESIDENT</p>	<p>SHEET NO: <b>CS1</b></p> <p>PAGE NO: <b>1</b></p>
	<p>Office of the President CARLOS HILADO MEMORIAL STATE UNIVERSITY Negros Occidental</p>						


**GENERAL NOTES:**

1. All wiring installations must conform with the latest requirement of the PHILIPPINE ELECTRICAL CODE, NATIONAL BUILDING CODE, FIRE CODE OF THE PHILIPPINES and the requirements of the local electric utility.
2. The source of power is from the proposed Unit 37.5 kva, 1-phase, 13200/7620V, distribution transformer, oil-immersed tapped from NOCECO 13200/7620 lines.
3. Service entrance wire shall be 2-80mm sq. THW & 1-22mm sq. THW (ground) in 50mm (2" dia.) RMC.
4. Main breaker shall be 175A, 2P, 240V bolt-on type.
5. No wire smaller than 3.5mm sq. THHN wire shall be used.
6. All wiring installation must be supervised by at least a licensed master electrician and monitored by an REE or PEE.
7. No work shall started without approved building permit.
8. All work must be done as reflected on the approved electrical plans.
9. Electrical outlets must be installed level and mounted above all computer desks and tables to ensure safe and proper access.

**4 GENERAL NOTES**

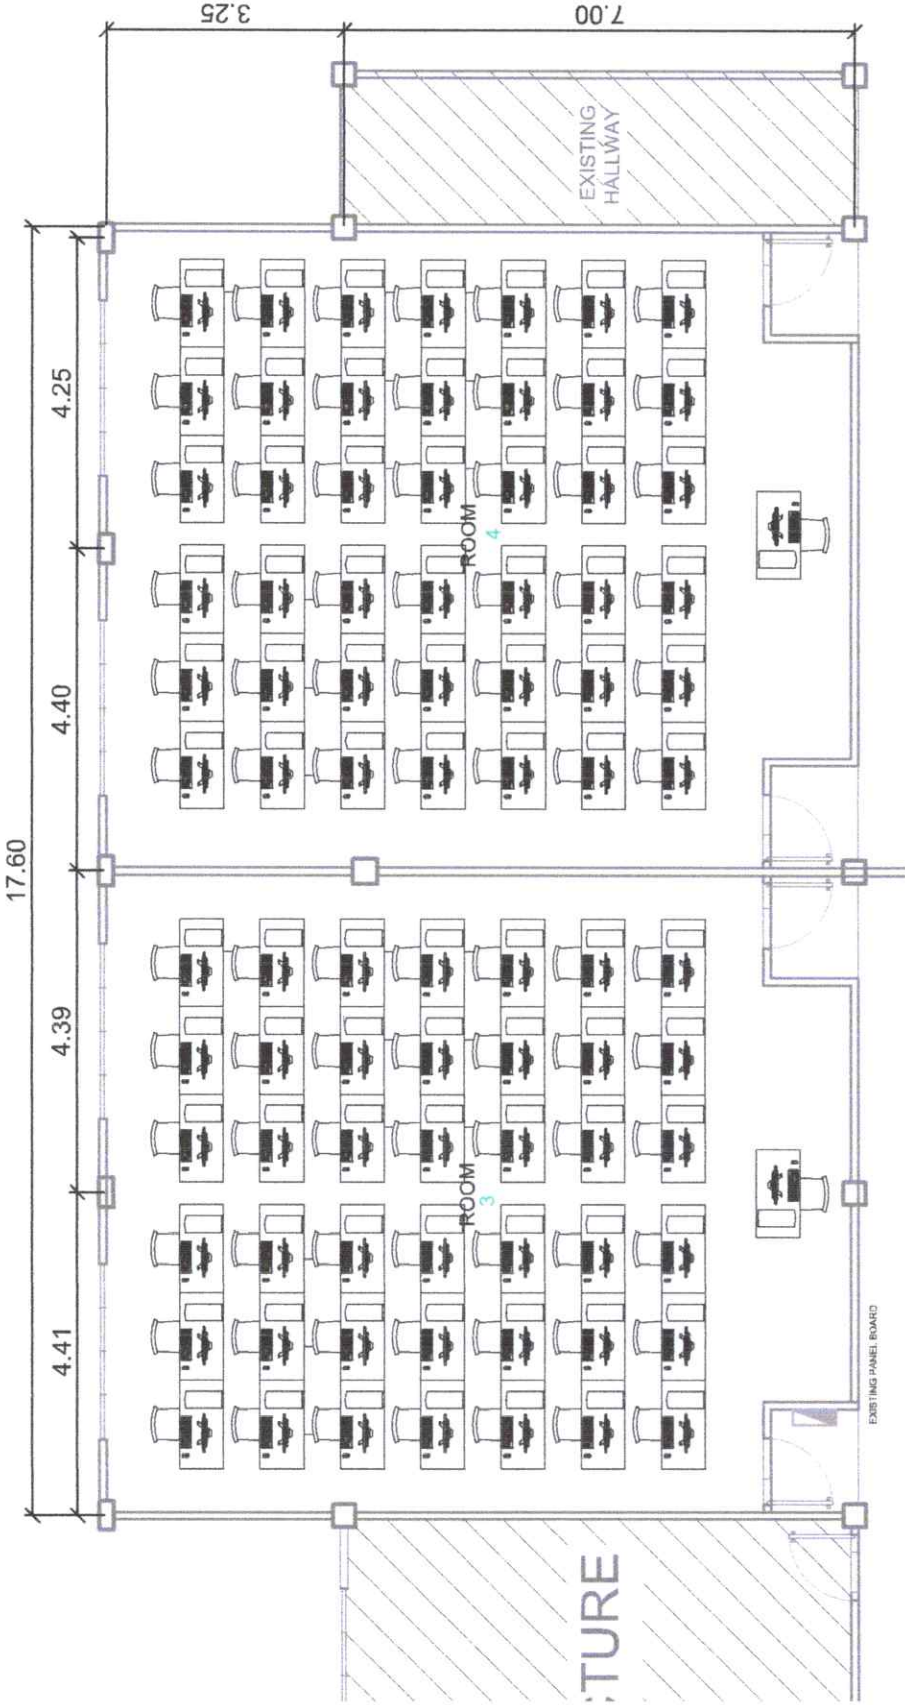

**3 FLOOR PLAN**



 <p>OFFICE OF THE PROJECT MANAGEMENT UNIT</p>	<p>PROJECT TITLE: Labor and Materials for Electrical Installation for Room 3 and 4-IT Laboratory</p> <p>PROJECT LOCATION: BINALAGAN CAMPUS</p>	<p>ENDORSED BY: <i>[Signature]</i> EVELLE B. VEGARA, EGD EXECUTIVE DIRECTOR, BINALAGAN CAMPUS</p>	<p>PREPARED BY: <i>[Signature]</i> MA. TERCIA M. LILATUBA ENGINEER, ELECTRICAL ENGINEERING, BINALAGAN CAMPUS</p>	<p>CHECKED BY: <i>[Signature]</i> ENGR. FAYOUB B. DESQUITADO PROJECT ELECTRICAL ENGINEER, BINALAGAN CAMPUS</p>	<p>RECOMMENDING APPROVAL: <i>[Signature]</i> ENGR. JUN J. MAÑEZ DIRECTOR, PROJECT MANAGEMENT UNIT AND FINANCE</p>	<p>APPROVED BY: <i>[Signature]</i> NORBERTO P. LANGULABNAN, Ph.D. SIC PRESIDENT III</p>	<p>SHEET NO: <b>E</b></p>	<p>PAGE NO: <b>13</b></p>
	<p>Republic of the Philippines CARLOS HILADO MEMORIAL STATE UNIVERSITY Binalagan Campus</p>							


17.60

4.40

4.40

4.40

4.40

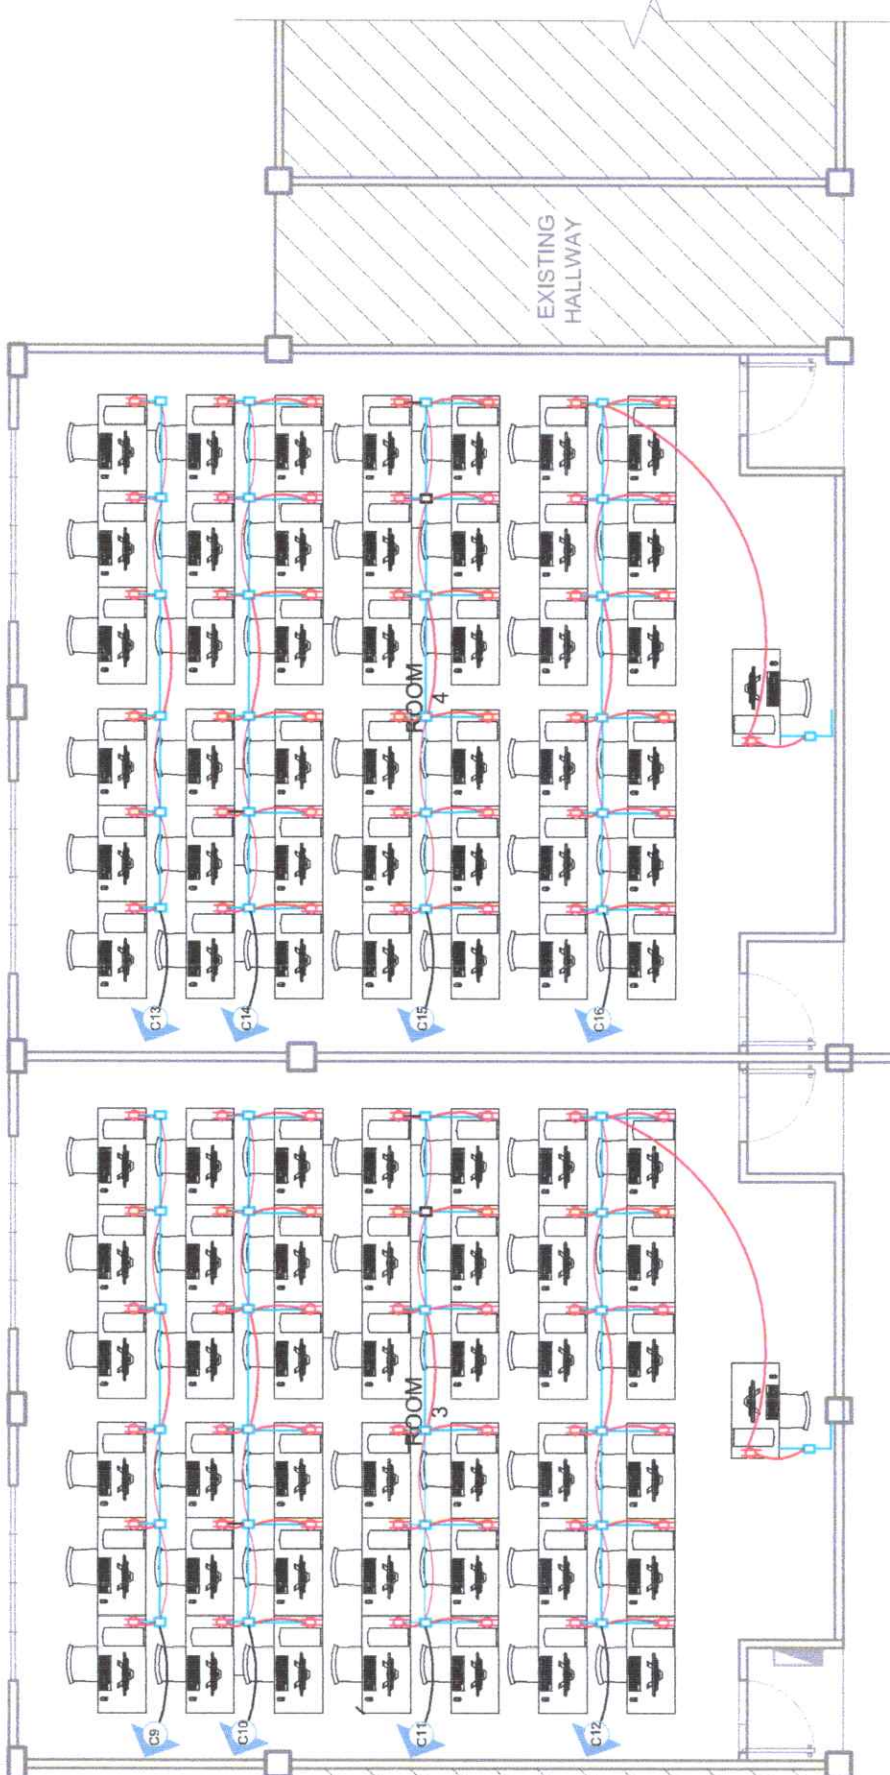

3.25

10.25

7.00

- ELECTRICAL WIRE
- PVC MOULDING
- PINLIGHT
- PANEL BOARD
- CIRCUIT HOME RUN
- SINGLE SWITCH
- TWO-GANG SWITCH
- AIR CONDITION UNIT
- EMERGENCY LIGHT
- SURFACE TYPE UTILITY BOX
- PLUG TO NEAREST OUTLET
- CONVENIENCE OUTLET



LEGEND

ELECTRICAL PLAN  
**CONVENIENCE OUTLET LAYOUT**




 <p>Republic of the Philippines  <b>CARLOS HILADO MEMORIAL STATE UNIVERSITY</b>      Negros Occidental</p> <p>OFFICE OF THE PROJECT MANAGEMENT UNIT</p>	<p><b>PROJECT TITLE:</b>          Labor and Materials for Electrical Installation for Room 3 and 4 - IT Laboratory</p> <p><b>PROJECT LOCATION:</b> BINALBAGAN CAMPUS</p>	<p><b>ENDORSED BY:</b></p> <p><i>Sheila</i>          SHEILA B. BERGARA, EGD          EXECUTIVE DIRECTOR, BINALBAGAN CAMPUS</p>	<p><b>PREPARED BY:</b></p> <p><i>John Carlo</i>          MA. LEONARDO M. VILLATURA          UNIVERSITY ASSISTANT PROFESSOR - BINALBAGAN CAMPUS</p> <p><i>John Carlo</i>          ENGR. JOHN CARLO F. GANON          CIVIL ENGINEER - BINALBAGAN CAMPUS</p>	<p><b>CHECKED BY:</b></p> <p><i>Engr. Paolo J. Desquitado</i>          ENGR. PAOLO J. DESQUITADO          PROFESSIONAL ELECTRICAL ENGINEER/PMU</p> <p><i>Engr. Romeo S. Chavez</i>          ENGR. ROMEO S. CHAVEZ          PROJECT SUPERVISOR - INCE III, PMU</p>	<p><b>RECOMMENDING APPROVAL:</b></p> <p><i>Jay B. Estivaldas</i>          JAY B. ESTIVALDAS, EGD.          VICE PRESIDENT FOR ADMINISTRATION AND FINANCE          DIRECTOR, PROJECT MANAGEMENT UNIT</p>	<p><b>APPROVED BY:</b></p> <p><i>Norberto M. Magulabnan</i>          NORBERTO M. MAGULABNAN, Ph.D.          SUC PRESIDENT III</p>	<p>SHEET NO: <b>E</b> PAGE NO: <b>23</b></p>
--	--	--	--	---	---	---	--

**SERVICE ENTRANCE**  
(COMPUTER LABORATORY)

2 - 80 sq. mm.<sup>2</sup>  
THHN WIRE IN  
2"Ø CONDUIT PIPE

**M KWH METER**

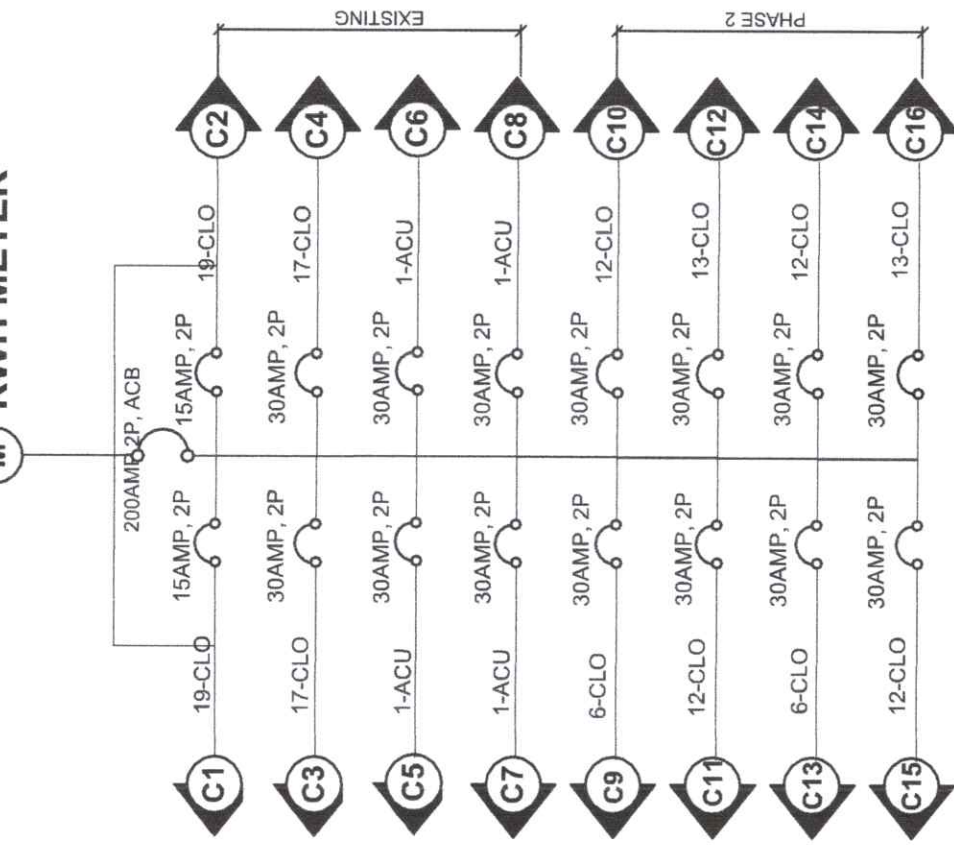

**2 SINGLE LINE DIAGRAM**

E3 SCALE 50 MTS

**SCHEDULE OF LOADS**

PB1	PKT. NO.	QTY.	DESCRIPTION	VA	VA TOTAL	VOLTS	AMPERES	PROTECTION	SIZE OF WIRE	SIZE OF CONDUIT
	C1	19	CEILING LIGHT OUTLET	100	1900	230	8.26	15A	2-3.5MM2 THHN	20MM2 PVC PIPE
	C2	19	CEILING LIGHT OUTLET	100	1900	230	8.26	15A	2-3.5MM2 THHN	20MM2 PVC PIPE
	C3	17	CONVENIENCE OUTLET	180	3060	230	13.30	30A	2-3.5MM2 THHN	20MM2 PVC PIPE
	C4	17	CONVENIENCE OUTLET	180	3060	230	13.30	30A	2-3.5MM2 THHN	20MM2 PVC PIPE
	C5	1	AIRCON OUTLET	2.5 HP	2331	230	10.13	30A	2-3.5MM2 THHN	20MM2 PVC PIPE
	C6	1	AIRCON OUTLET	2.5 HP	2331	230	10.13	30A	2-3.5MM2 THHN	20MM2 PVC PIPE
	C7	1	AIRCON OUTLET	2.5 HP	2331	230	10.13	30A	2-3.5MM2 THHN	20MM2 PVC PIPE
	C8	1	AIRCON OUTLET	2.5 HP	2331	230	10.13	30A	2-3.5MM2 THHN	20MM2 PVC PIPE
	C9	6	CONVENIENCE OUTLET	180	1080	230	4.70	30A	2-5.5MM2 THHN	20MM2 PVC PIPE
	C10	12	CONVENIENCE OUTLET	180	2160	230	9.40	30A	2-5.5MM2 THHN	20MM2 PVC PIPE
	C11	12	CONVENIENCE OUTLET	180	2160	230	9.40	30A	2-5.5MM2 THHN	20MM2 PVC PIPE
	C12	13	CONVENIENCE OUTLET	180	2340	230	10.17	30A	2-5.5MM2 THHN	20MM2 PVC PIPE
	C13	6	CONVENIENCE OUTLET	180	1080	230	4.70	30A	2-5.5MM2 THHN	20MM2 PVC PIPE
	C14	12	CONVENIENCE OUTLET	180	2160	230	9.40	30A	2-5.5MM2 THHN	20MM2 PVC PIPE
	C15	12	CONVENIENCE OUTLET	180	2160	230	9.40	30A	2-5.5MM2 THHN	20MM2 PVC PIPE
	C16	13	CONVENIENCE OUTLET	180	2340	230	10.17	30A	2-5.5MM2 THHN	20MM2 PVC PIPE
	TOTAL						150.98			

$$I = (150.98 \times 1.25) / 0.8$$

$$= (188.73) / 0.8$$

$$= 235.91 \text{ AMPERES}$$

USE: 200 AT, 2P CIRCUIT BREAKER  
80MM2 THHN IN 2"Ø RCS  
+ 1-3.5MM(G)

**1 SCHEDULE OF LOADS**

E3 SCALE 50 MTS



Republic of the Philippines  
**CARLOS HILADO MEMORIAL STATE UNIVERSITY**  
Negros Occidental  
OFFICE OF THE PROJECT MANAGER/IBB

ENDORSED BY:  
JOYELLE B. VILLAGARA, EGD  
PROJECT DIRECTOR, BINALBAGAN CAMPUS

PREPARED BY:  
WA. LEONILA M. VILLAGARA  
PROJECT MANAGER, BINALBAGAN CAMPUS

CHECKED BY:  
ENGR. ANTONIO B. DEQUITADO  
PROJECT MANAGER, BINALBAGAN CAMPUS

RECOMMENDING APPROVAL:  
ENGR. JUDITH J. MARCOS  
DIRECTOR, PROJECT MANAGEMENT UNIT AND FINANCE

JAY B. ESTRELLAS, EGD  
VICE PRESIDENT FOR ADMINISTRATION AND FINANCE

APPROVED BY:  
NORBERTO P. MANGULABNAN, Ph.D  
SUC PRESIDENT III